



PROJECT:
SWA3300 ALUMINUM SURFACE RACEWAY
 PRE-WIRED RACEWAYS SYSTEM
 -INSTALLATION INSTRUCTIONS-

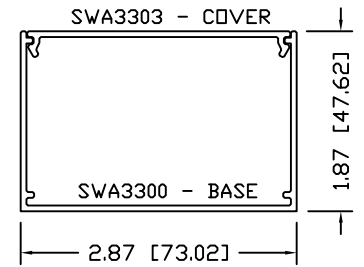

	 MONO-SYSTEMS, INC. <small>UNIQUE CABLE DISTRIBUTION SOLUTIONS</small>	<i>DRAWING TITLE:</i>		<i>DR. BY:</i>	
		INSTALLATION INSTRUCTIONS COVER SHEET		MJL	
<i>PART NUMBER:</i>	<i>BUFFALO OFFICE:</i>	<i>CORPORATE OFFICE:</i>	<i>PROJECT:</i>	<i>SCALE:</i>	<i>DWG. NO.:</i>
COVER SHEET	180 HOPKINS STREET BUFFALO, NEW YORK 14220 PHONE: (716)-821-1344 FAX: (716)-821-1345	4 INTERNATIONAL DRIVE RYE BROOK, NEW YORK 10573 PHONE: (914) 934-2075 FAX: (914) 934-2190	PRE-WIRED RACEWAY SYSTEM	NONE	
			<i>DATE:</i>	<i>REV. 0</i>	
			01/12/2009		

SnapWay™ M.S.I. P/N: SWA3300
 SWA3300 Series SURFACE RACEWAY BASE SECTION

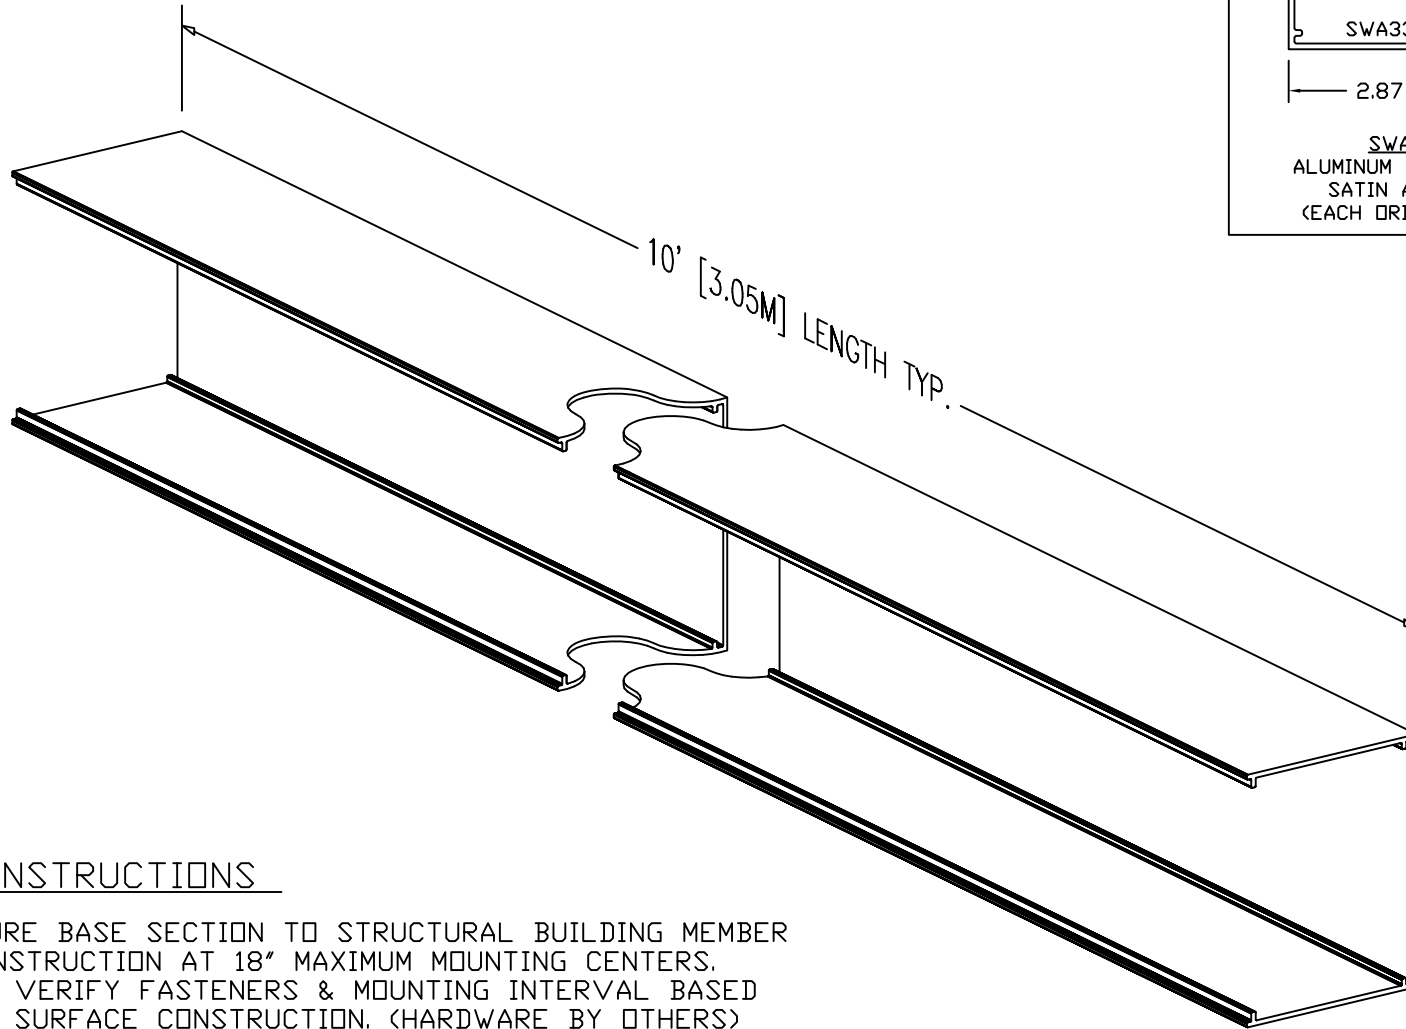

SWA3300 SERIES
 ALUMINUM RACEWAY - SECTION
 SATIN ANNOXIDIZED FINISH
 (EACH ORDERED SEPARATELY)

ASSEMBLY INSTRUCTIONS

1. RIGIDLY SECURE BASE SECTION TO STRUCTURAL BUILDING MEMBER OR WALL CONSTRUCTION AT 18" MAXIMUM MOUNTING CENTERS. ENGINEER TO VERIFY FASTENERS & MOUNTING INTERVAL BASED ON MOUNTING SURFACE CONSTRUCTION. (HARDWARE BY OTHERS)

MATERIAL: #6063-T6 EXTRUDED ALUMINUM.
 NOMINAL WALL THICKNESS 0.060".

09/29/04 DOCUMENT REF. NO.: SWA3300.DWG




MONO-SYSTEMS, INC.
 UNIQUE CABLE DISTRIBUTION SOLUTIONS
 4 INTERNATIONAL DRIVE
 RYE BROOK, NEW YORK 10573
 PHONE: (914)-934-2075
 FAX: (914)-934-2190


SnapWay™

SWA3300 Series


M.S.I. P/N: SWA3302
SPLICE CONNECTOR

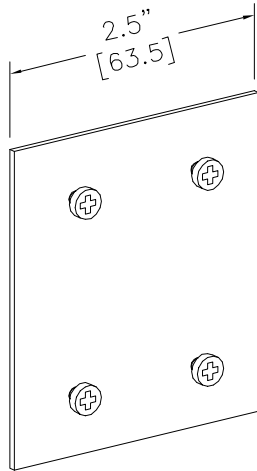

SWA3302

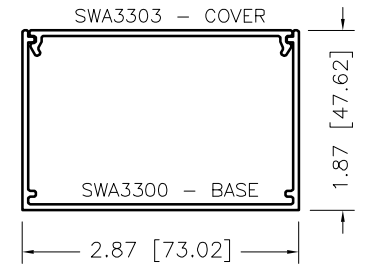

SWA3300 SERIES
ALUMINUM RACEWAY – SECTION
SATIN ANNOXIDIZED FINISH
(EACH ORDERED SEPARATELY)

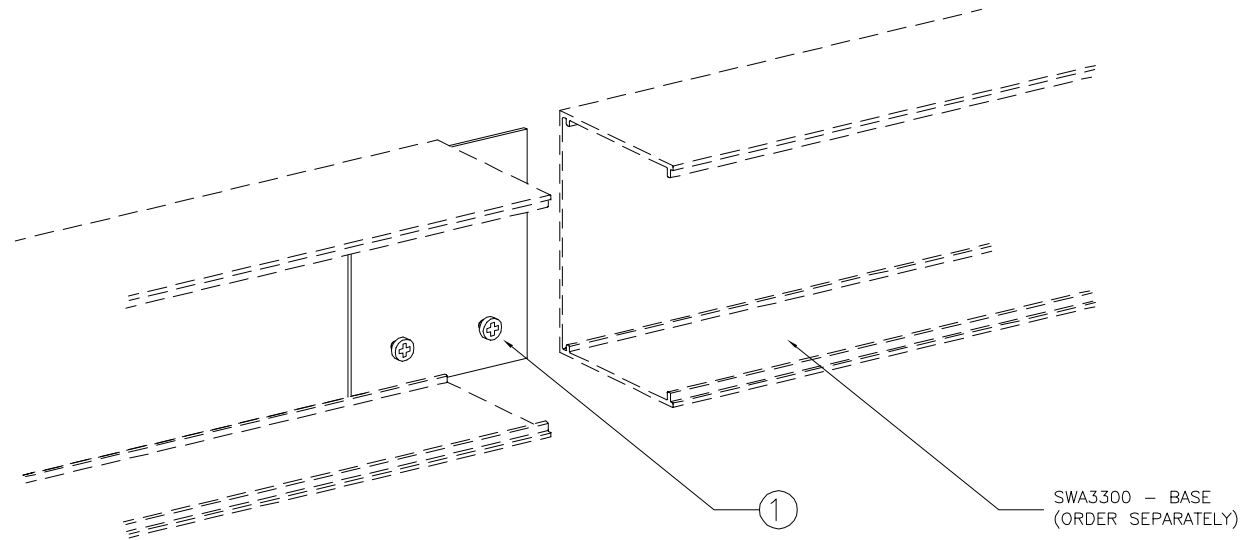

ASSEMBLY INSTRUCTIONS

1. INSERT COUPLING INTO ENDS OF BASE SECTIONS TO BE JOINED. SECURE IN PLACE USING FOUR PROVIDED 8-32 X 3/16" SCREWS.

MATERIAL: 0.060" ALUMINUM.

09/29/04 DOCUMENT REF. NO.: SWA3302.DWG




MONO-SYSTEMS, INC.
UNIQUE CABLE DISTRIBUTION SOLUTIONS
4 INTERNATIONAL DRIVE
RYE BROOK, NEW YORK 10573
PHONE: (914)-934-2075
FAX: (914)-934-2190


SnapWay™

SWA3300 Series

M.S.I. P/N: SWA3303
SURFACE RACEWAY COVER

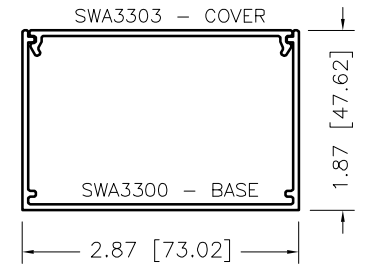

SWA3300 SERIES
ALUMINUM RACEWAY - SECTION
SATIN ANNOXIDIZED FINISH
(EACH ORDERED SEPARATELY)

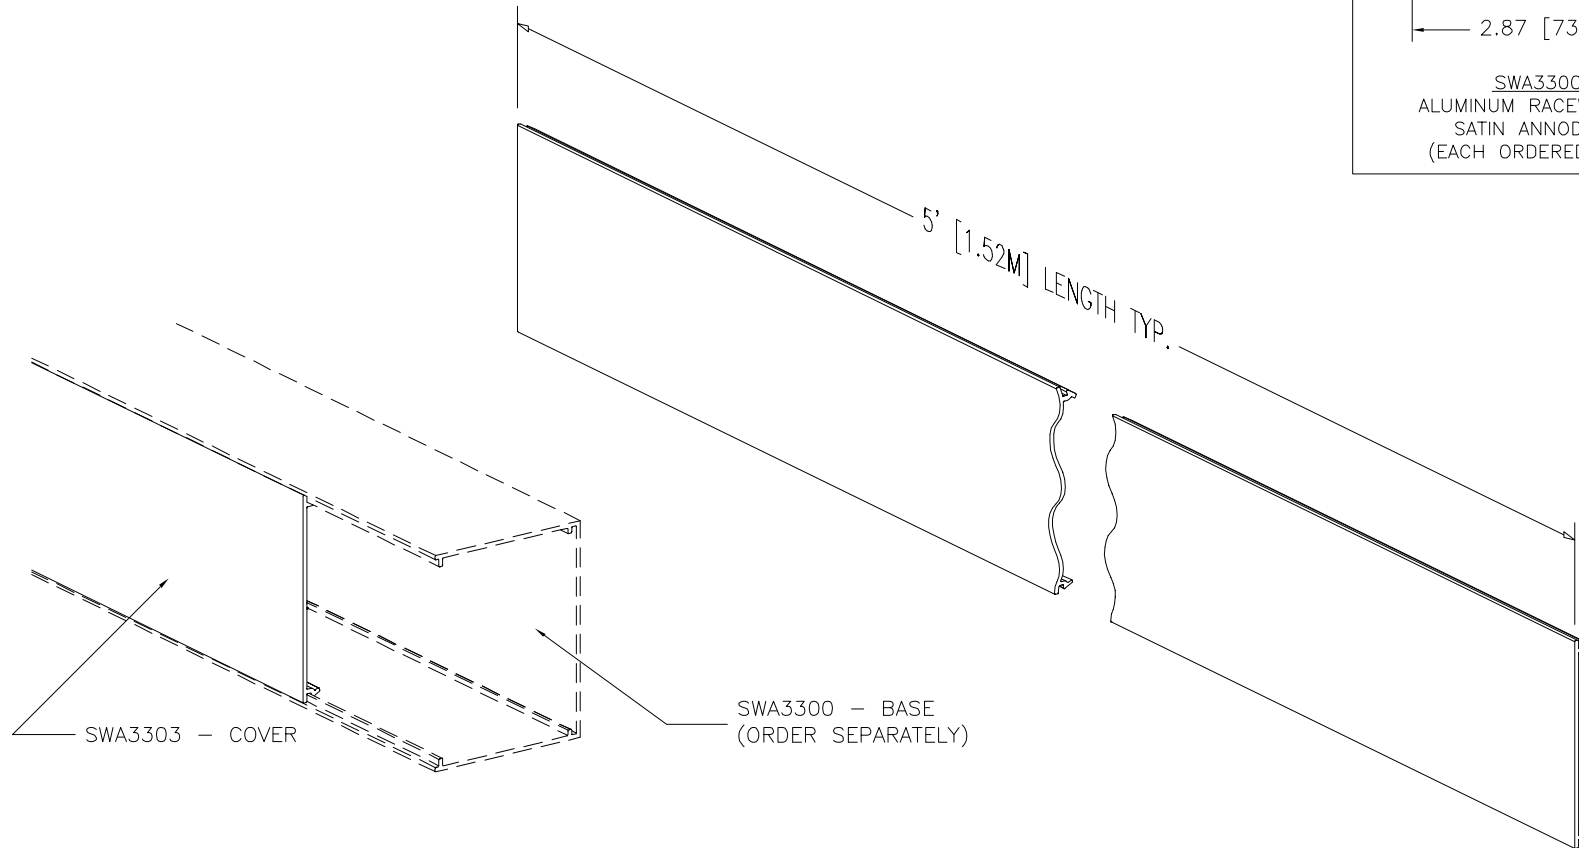

ASSEMBLY INSTRUCTIONS

1. FIRMLY PRESS COVER INTO PLACE ENSURING THAT BOTH SIDES ARE COMPLETELY SNAPPED INTO BASE SECTION.

MATERIAL: #6063-T6 EXTRUDED ALUMINUM.
NOMINAL WALL THICKNESS 0.060".

09/29/04 DOCUMENT REF. NO.: SWA3303.DWG





MONO-SYSTEMS, INC.
UNIQUE CABLE DISTRIBUTION SOLUTIONS
4 INTERNATIONAL DRIVE
RYE BROOK, NEW YORK 10573
PHONE: (914)-934-2075
FAX: (914)-934-2190


SnapWay™

SWA3300 Series

M.S.I. P/N: SWA3304
BLANK END

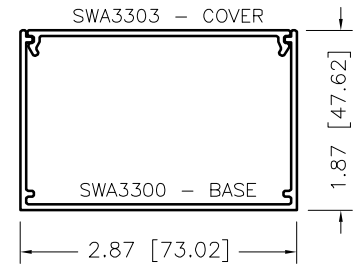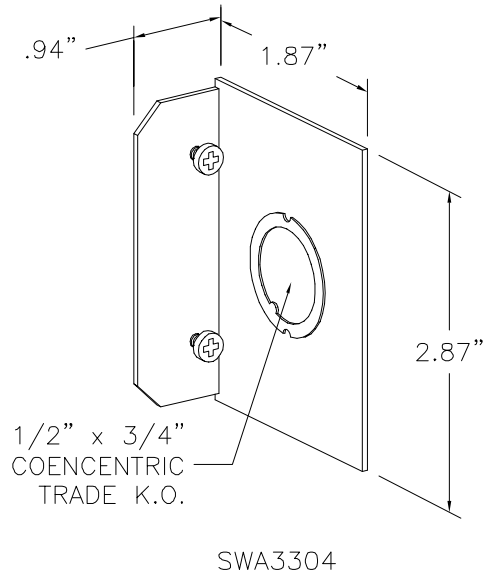

SWA3300 SERIES
ALUMINUM RACEWAY – SECTION
SATIN ANNOIDIZED FINISH
(EACH ORDERED SEPARATELY)

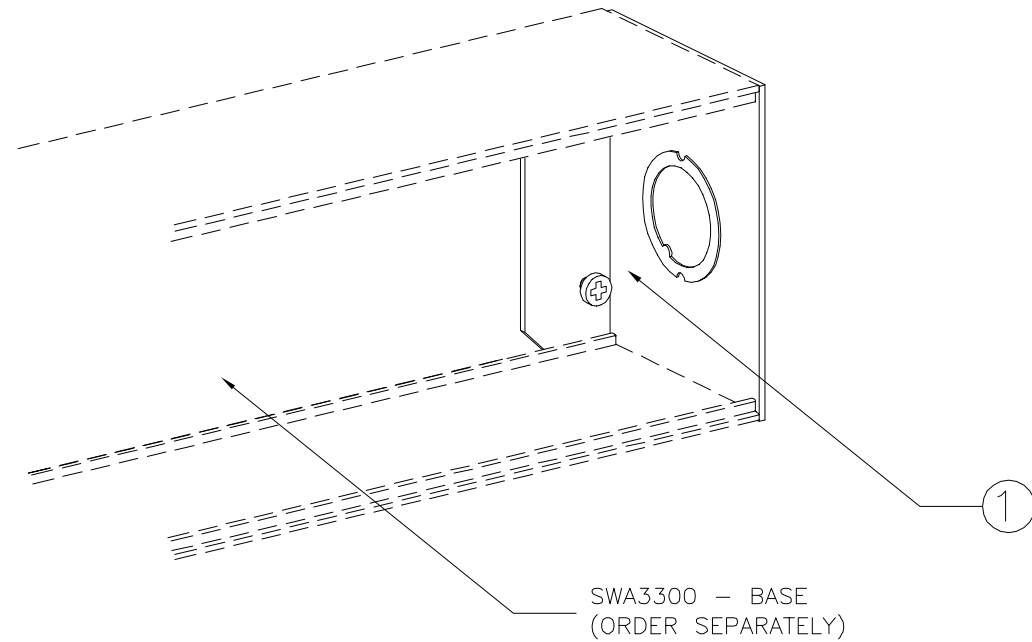

ASSEMBLY INSTRUCTIONS

1. INSERT BLANK END FULLY INTO SMS3200 BASE SECTION.
SECURE USING PROVIDED 8-32 X 3/16" SCREWS.

MATERIAL: 0.060" ALUMINUM.

09/29/04 DOCUMENT REF. NO.: SWA3304.DWG




MONO-SYSTEMS, INC.
UNIQUE CABLE DISTRIBUTION SOLUTIONS
4 INTERNATIONAL DRIVE
RYE BROOK, NEW YORK 10573
PHONE: (914)-934-2075
FAX: (914)-934-2190

SnapWay™

SWA3300 Series

M.S.I. P/N: SWA3309
90° FLAT ELBOW


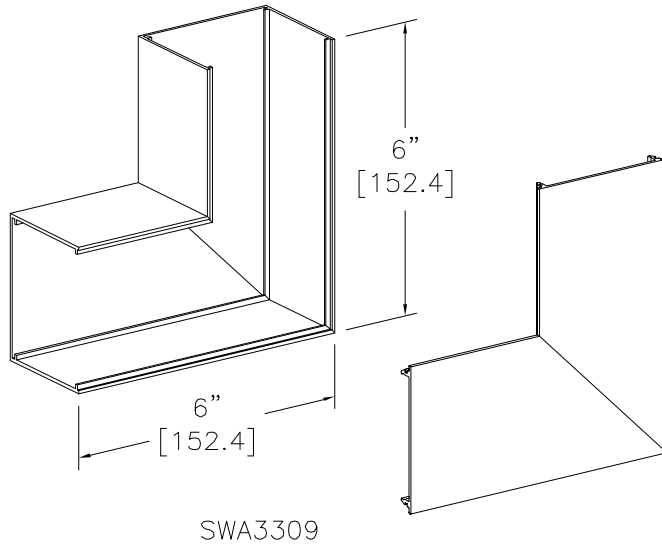


ASSEMBLY INSTRUCTIONS

1. CONNECT 90° FLAT ELBOW TO SWA3300 BASE SECTIONS USING SWA3302 COUPLINGS. (TWO PLACES) (SWA3302 ORDERED SEPARATELY)
2. SECURE ELBOW TO BASE SECTIONS BY TIGHTENING 8-32 X 3/16" SCREWS. (8 PLACES TYP.)
3. SNAP COVER INTO PLACE.

MATERIAL: #6063-T6 EXTRUDED ALUMINUM.
NOMINAL WALL THICKNESS 0.060".

09/29/04 DOCUMENT REF. NO.: SWA3309.DWG

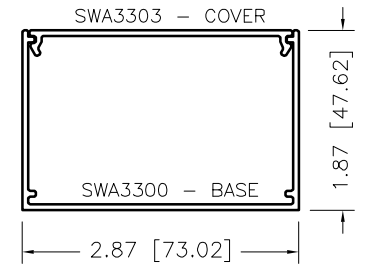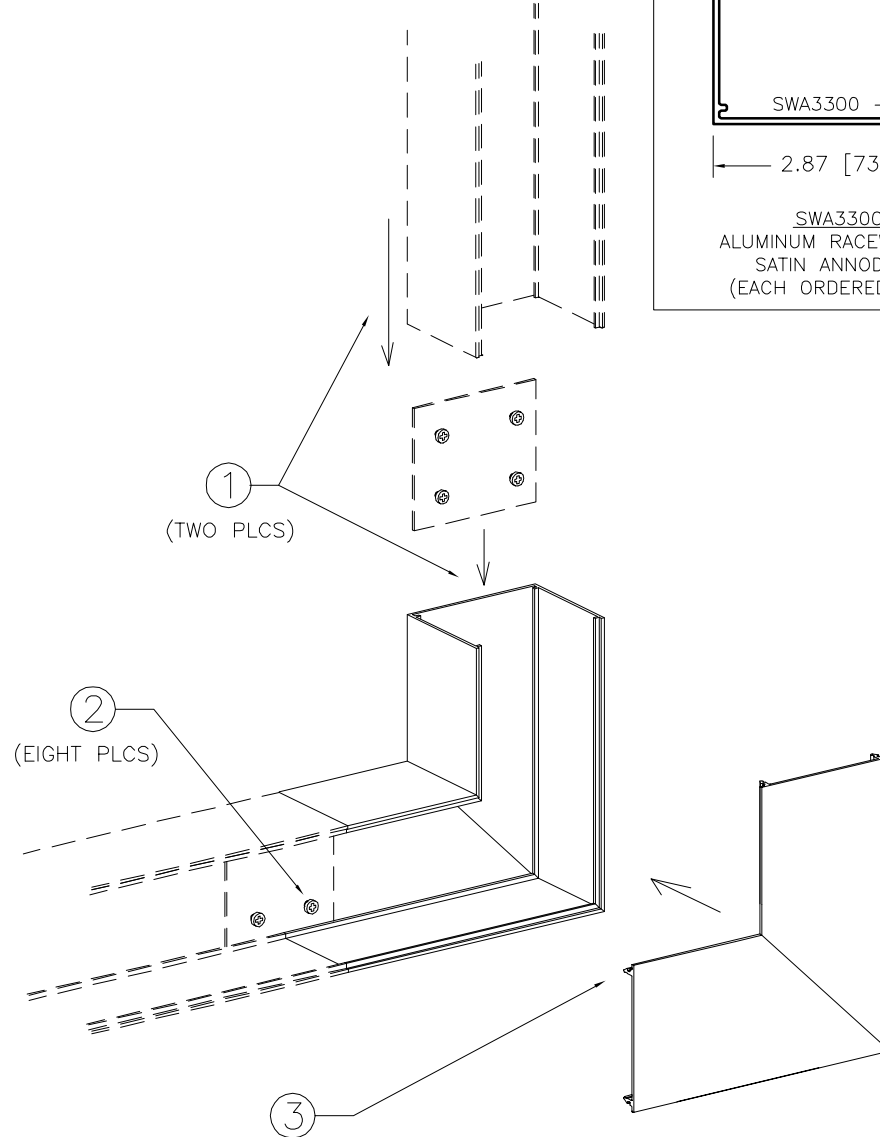

SWA3300 SERIES
ALUMINUM RACEWAY - SECTION
SATIN ANNOXIDIZED FINISH
(EACH ORDERED SEPARATELY)





MONO-SYSTEMS, INC.
UNIQUE CABLE DISTRIBUTION SOLUTIONS
4 INTERNATIONAL DRIVE
RYE BROOK, NEW YORK 10573
PHONE: (914)-934-2075
FAX: (914)-934-2190

SnapWay™

SWA3300 Series

M.S.I. P/N: SWA3310
TEE

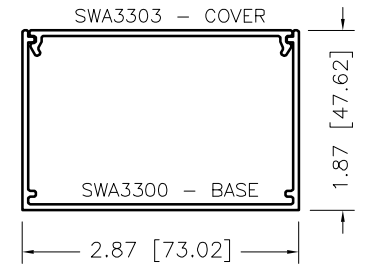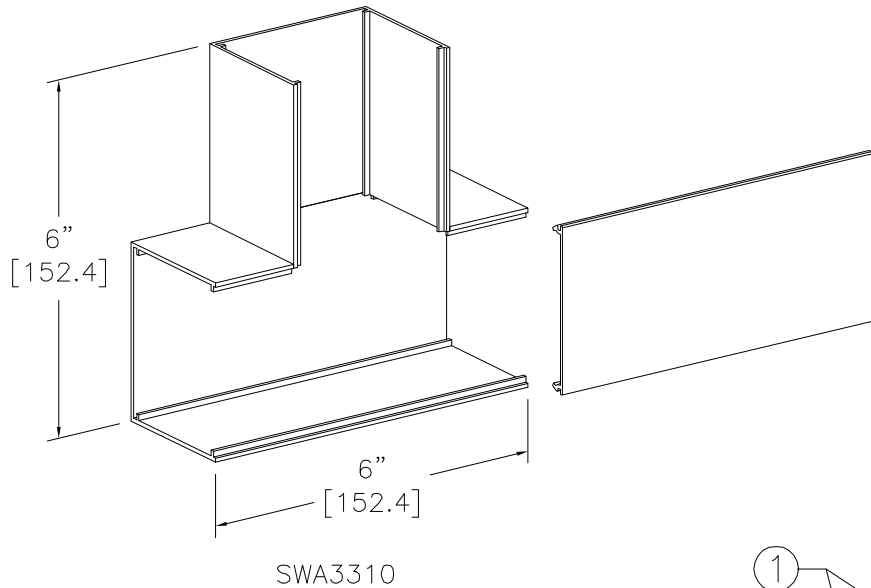


SWA3300 SERIES
ALUMINUM RACEWAY - SECTION
SATIN ANNOXIDIZED FINISH
(EACH ORDERED SEPARATELY)

②
(12 PLCS)

①
(3 PLCS)

ASSEMBLY INSTRUCTIONS

1. CONNECT TEE TO SWA3300 BASE SECTIONS USING SWA3302 COUPLINGS. (THREE PLACES) (SWA3302 ORDERED SEPARATELY)
2. SECURE TEE TO BASE SECTIONS BY TIGHTENING 8-32 X 3/16" SCREWS. (12 PLACES TYP.)
3. SNAP COVER INTO PLACE.

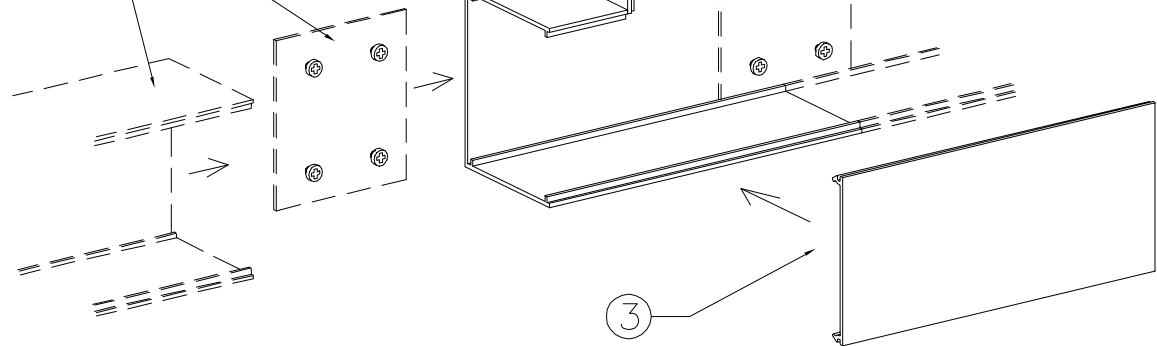

MATERIAL: #6063-T6 EXTRUDED ALUMINUM.
NOMINAL WALL THICKNESS 0.060".

09/29/04 DOCUMENT REF. NO.: SWA3310.DWG





MONO-SYSTEMS, INC.
UNIQUE CABLE DISTRIBUTION SOLUTIONS
4 INTERNATIONAL DRIVE
RYE BROOK, NEW YORK 10573
PHONE: (914)-934-2075
FAX: (914)-934-2190

SnapWay™

SWA3300 Series


M.S.I. P/N: SWA3314
90° INTERNAL ELBOW

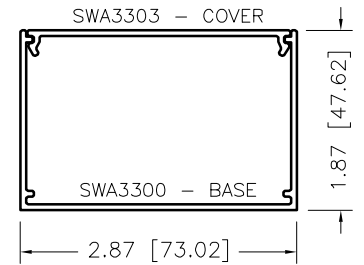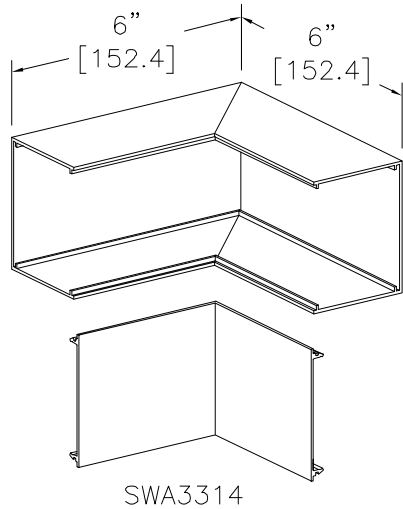

SWA3300 SERIES
ALUMINUM RACEWAY – SECTION
SATIN ANNOIDIZED FINISH
(EACH ORDERED SEPARATELY)

ASSEMBLY INSTRUCTIONS

1. CONNECT SWA3314 TO SWA3300 BASE SECTIONS USING SWA3302 COUPLINGS. (TWO PLACES)
(SWA3302 ORDERED SEPARATELY)
2. SECURE ELBOW TO BASE SECTIONS BY TIGHTENING 8-32 X 3/16" SCREWS. (8 PLACES TYP.)
3. SNAP COVER INTO PLACE.

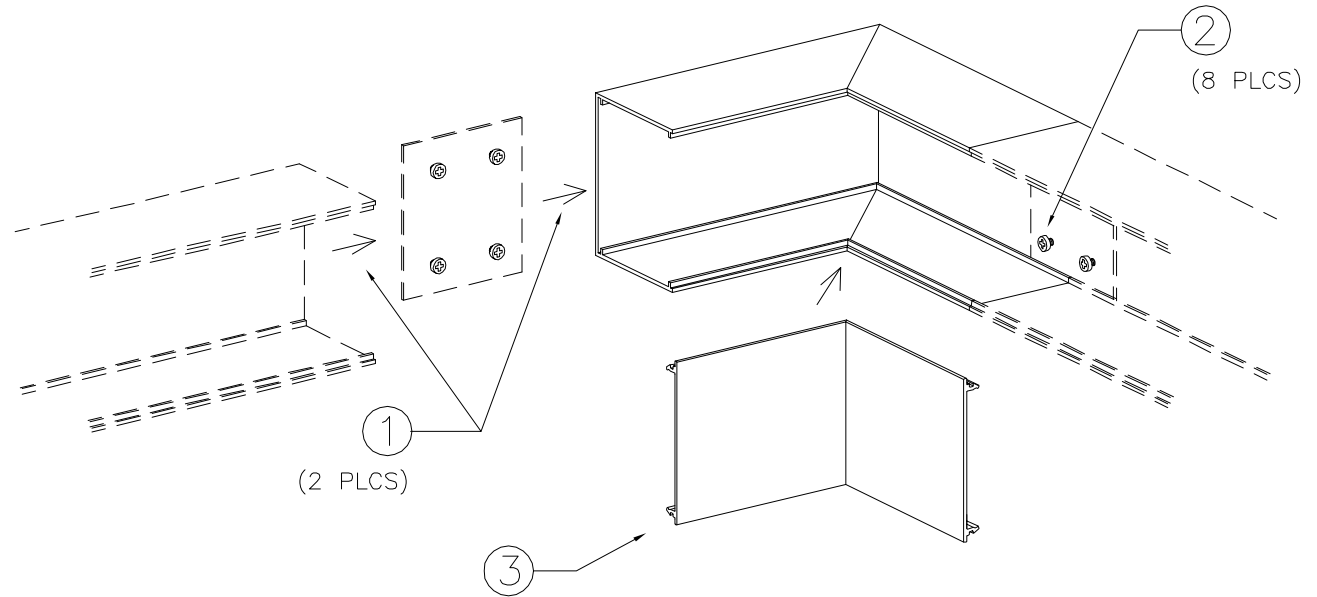

MATERIAL: #6063-T6 EXTRUDED ALUMINUM.
NOMINAL WALL THICKNESS 0.060".

09/29/04 DOCUMENT REF. NO.: SWA3314.DWG




MONO-SYSTEMS, INC.
UNIQUE CABLE DISTRIBUTION SOLUTIONS
4 INTERNATIONAL DRIVE
RYE BROOK, NEW YORK 10573
PHONE: (914)-934-2075
FAX: (914)-934-2190


SnapWay™

SWA3300 Series

M.S.I. P/N: SWA3318
90° EXTERNAL ELBOW

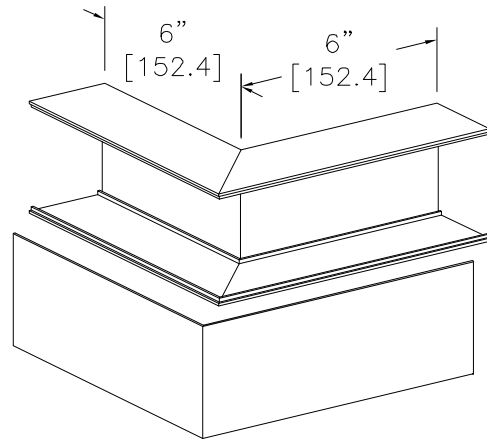


SWA3318

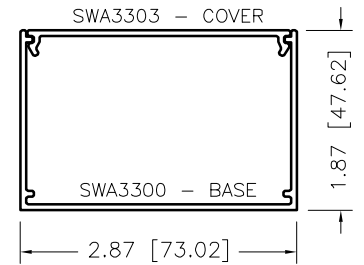

SWA3300 SERIES
ALUMINUM RACEWAY – SECTION
SATIN ANNOXIDIZED FINISH
(EACH ORDERED SEPARATELY)

ASSEMBLY INSTRUCTIONS

1. CONNECT SWA3318 TO SWA3300 BASE SECTIONS USING SWA3302 COUPLINGS. (TWO PLACES)
(SWA3302 ORDERED SEPARATELY)
2. SECURE ELBOW TO BASE SECTIONS BY TIGHTENING 8-32 X 3/16" SCREWS. (8 PLACES TYP.)
3. SNAP COVER INTO PLACE.

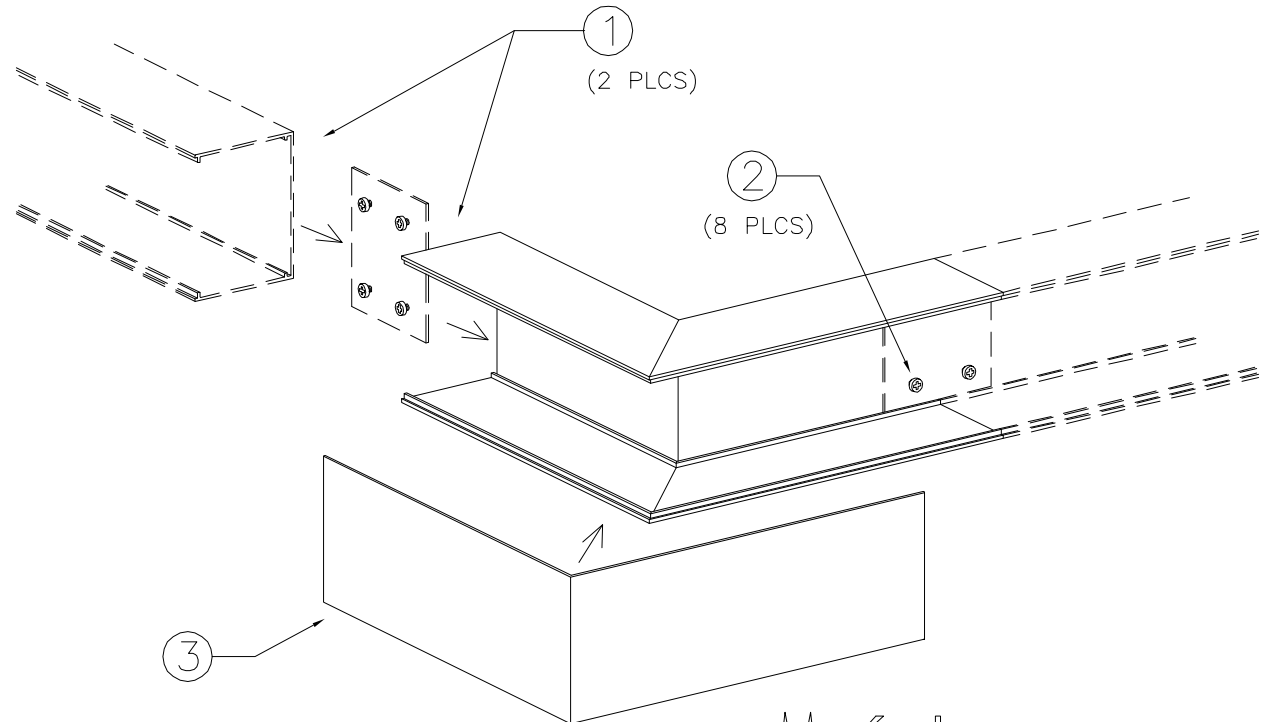

MATERIAL: #6063-T6 EXTRUDED ALUMINUM.
NOMINAL WALL THICKNESS 0.060".

09/29/04 DOCUMENT REF. NO.: SWA3318.DWG




MONO-SYSTEMS, INC.
UNIQUE CABLE DISTRIBUTION SOLUTIONS
4 INTERNATIONAL DRIVE
RYE BROOK, NEW YORK 10573
PHONE: (914)-934-2075
FAX: (914)-934-2190


SnapWay™

SWA3300 Series

M.S.I. P/N: SWA3323
RECTANGULAR PLATE

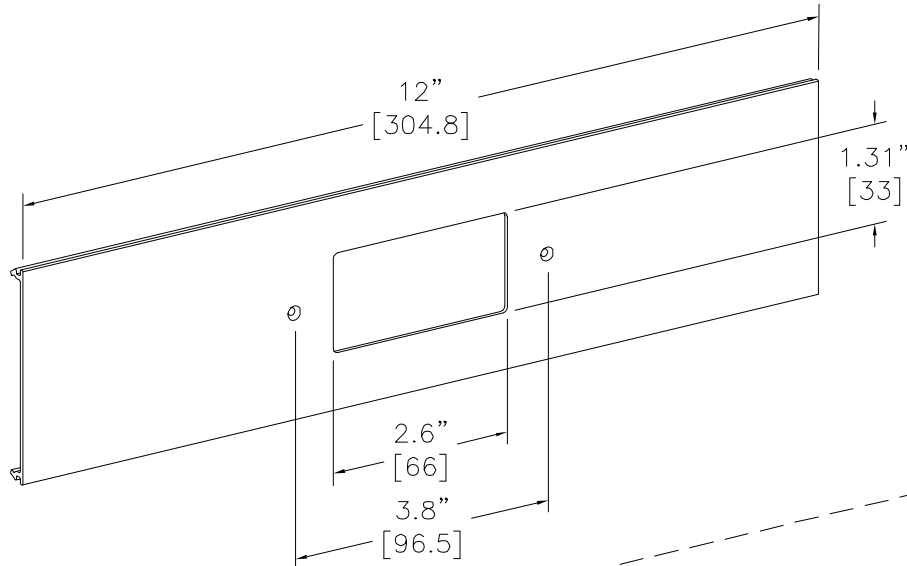

SWA3323

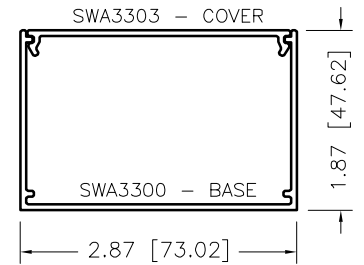

SWA3300 SERIES
ALUMINUM RACEWAY - SECTION
SATIN ANNOXIDIZED FINISH
(EACH ORDERED SEPARATELY)

②
(2 PLCS)

③

ASSEMBLY INSTRUCTIONS

1. TERMINATE DEVICE WIRING AND GROUND PER NEC AND LOCAL CODES. (BY OTHERS)
2. SECURE DEVICE TO PLATE. (DEVICE & HARDWARE BY OTHERS)
3. SNAP COVER INTO PLACE.

MATERIAL: #6063-T6 EXTRUDED ALUMINUM.
NOMINAL WALL THICKNESS 0.060".

09/29/04 DOCUMENT REF. NO.: SWA3323.DWG





MONO-SYSTEMS, INC.
UNIQUE CABLE DISTRIBUTION SOLUTIONS
4 INTERNATIONAL DRIVE
RYE BROOK, NEW YORK 10573
PHONE: (914)-934-2075
FAX: (914)-934-2190

SnapWay™

SWA3300 Series

M.S.I. P/N: SWA3345
SINGLE RECEPTACLE PLATE

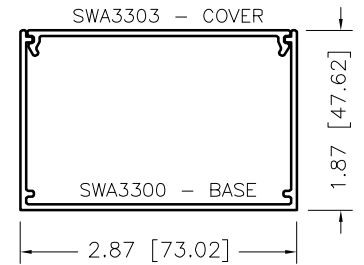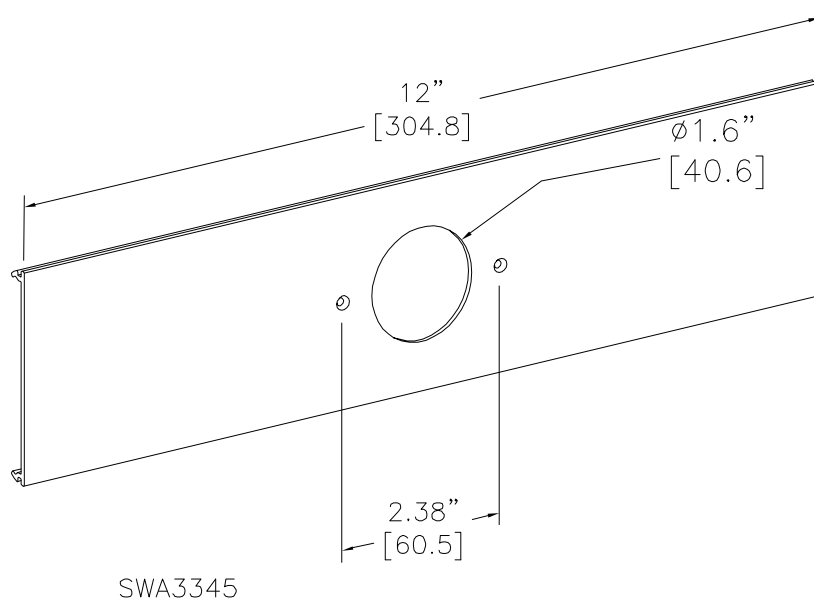

SWA3300 SERIES
ALUMINUM RACEWAY – SECTION
SATIN ANNOXIDIZED FINISH
(EACH ORDERED SEPARATELY)

②
(2 PLCS)

ASSEMBLY INSTRUCTIONS

1. TERMINATE DEVICE WIRING AND GROUND PER NEC AND LOCAL CODES. (BY OTHERS)
2. SECURE DEVICE TO PLATE. (DEVICE & HARDWARE BY OTHERS)
3. SNAP COVER INTO PLACE.

MATERIAL: #6063-T6 EXTRUDED ALUMINUM.
NOMINAL WALL THICKNESS 0.060".

09/29/04 DOCUMENT REF. NO.: SWA3345.DWG





MONO-SYSTEMS, INC.
UNIQUE CABLE DISTRIBUTION SOLUTIONS
4 INTERNATIONAL DRIVE
RYE BROOK, NEW YORK 10573
PHONE: (914)-934-2075
FAX: (914)-934-2190

SnapWay™

SWA3300 Series


M.S.I. P/N: SWA3346
 DUPLEX RECEPTACLE PLATE

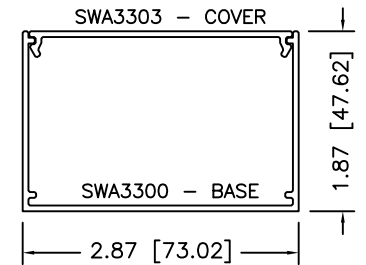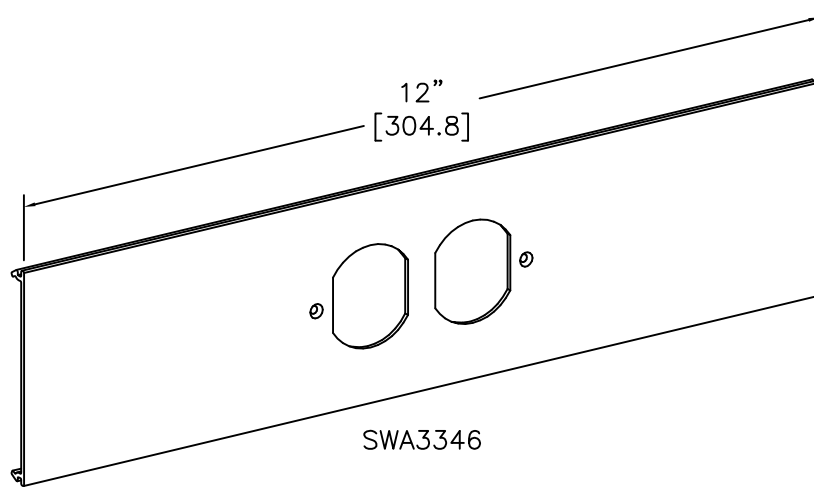

SWA3300 SERIES
 ALUMINUM RACEWAY – SECTION
 SATIN ANNOXIDIZED FINISH
 (EACH ORDERED SEPARATELY)

ASSEMBLY INSTRUCTIONS

1. TERMINATE DEVICE WIRING AND GROUND PER NEC AND LOCAL CODES. (BY OTHERS)
2. SECURE DEVICE TO PLATE. (DEVICE & HARDWARE BY OTHERS)
3. SNAP COVER INTO PLACE.
4. WHEN UTILIZING POWER DEVICES, FIELD DRILL ADDITIONAL HOLES TO SECURE DEVICES AT MORE THAN ONE POINT. (ADDITIONAL HARDWARE BY OTHERS)

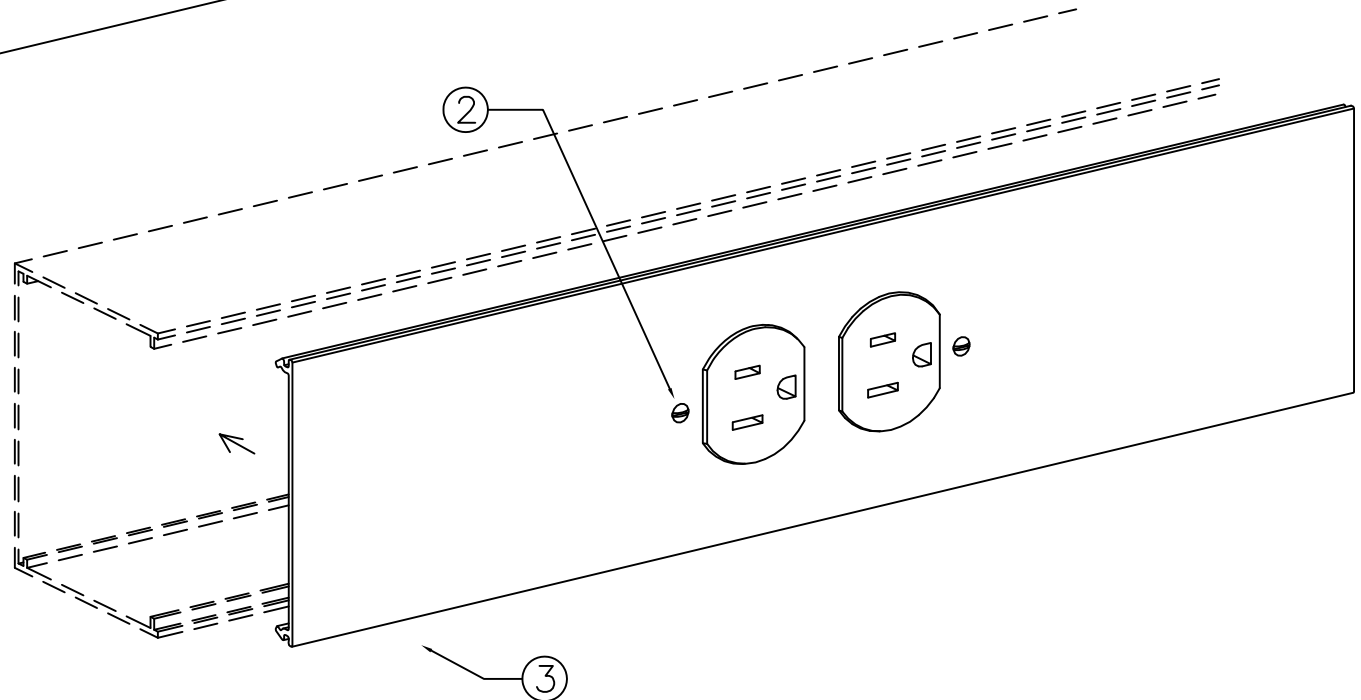

MATERIAL: #6063-T6 EXTRUDED ALUMINUM.
 NOMINAL WALL THICKNESS 0.060".

09/29/04 DOCUMENT REF. NO.: SWA3346.DWG




MONO-SYSTEMS, INC.
 UNIQUE CABLE DISTRIBUTION SOLUTIONS
 4 INTERNATIONAL DRIVE
 RYE BROOK, NEW YORK 10573
 PHONE: (914)-934-2075
 FAX: (914)-934-2190



SnapWay™

SWA3300 Series

M.S.I. P/N: SWA3346A
OFFSET DUPLEX RECEPTACLE PLATE

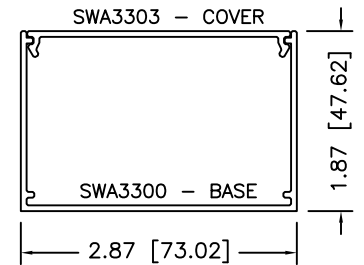


SWA3300 SERIES
ALUMINUM RACEWAY - SECTION
SATIN ANNOXIDIZED FINISH
(EACH ORDERED SEPARATELY)

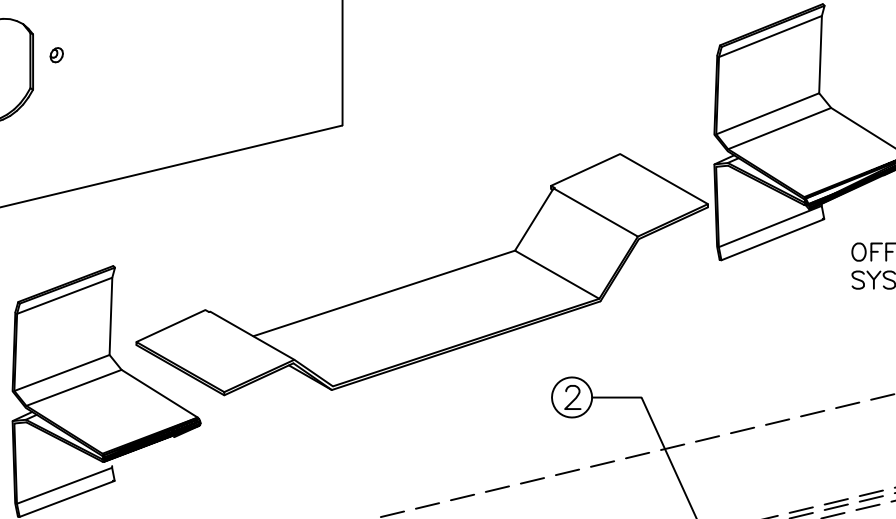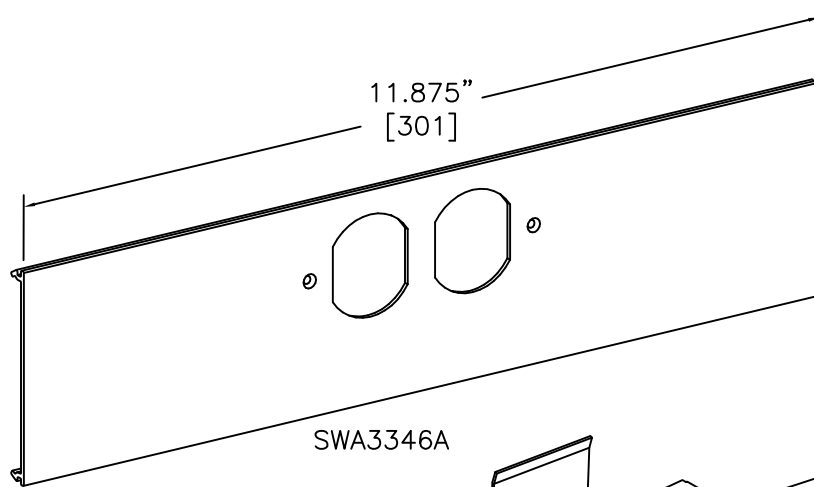

ASSEMBLY INSTRUCTIONS

1. TERMINATE DEVICE WIRING AND GROUND PER NEC AND LOCAL CODES. (BY OTHERS)
2. SECURE DEVICE TO PLATE. (DEVICE & HARDWARE BY OTHERS)
3. SNAP COVER INTO PLACE.

MATERIAL: #6063-T6 EXTRUDED ALUMINUM.
NOMINAL WALL THICKNESS 0.060".

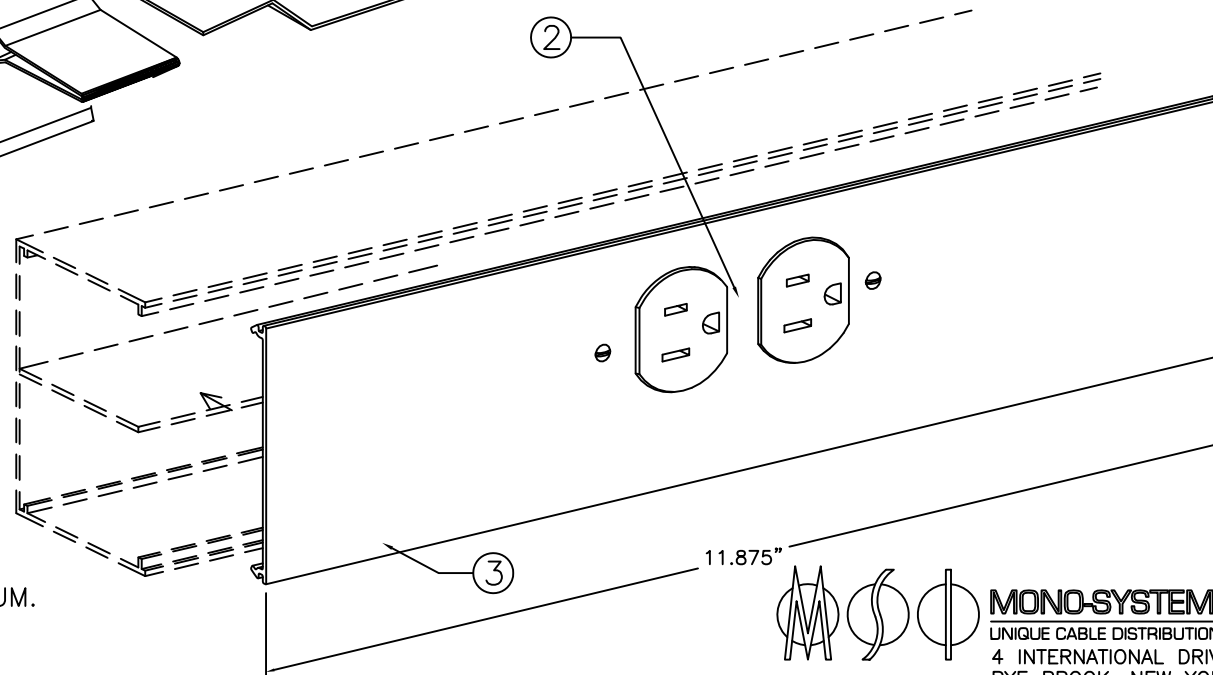

09/29/04 DOCUMENT REF. NO.: SWA3346.DWG



MONO-SYSTEMS, INC.
UNIQUE CABLE DISTRIBUTION SOLUTIONS
4 INTERNATIONAL DRIVE
RYE BROOK, NEW YORK 10573
PHONE: (914)-934-2075
FAX: (914)-934-2190